


NOTES:

- SECURE PIPE TO WALLS WITH STAINLESS STEEL STRAPS 4' ON CENTER.
- WOOD SHALL NOT BE USED.
- ALL PIPES AND FITTINGS SHALL BE SDR 21 OR SDR 26.
- NO GLUE FITTINGS, JOINTS OR BUSHINGS SHALL BE USED.
- CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING FLOW.

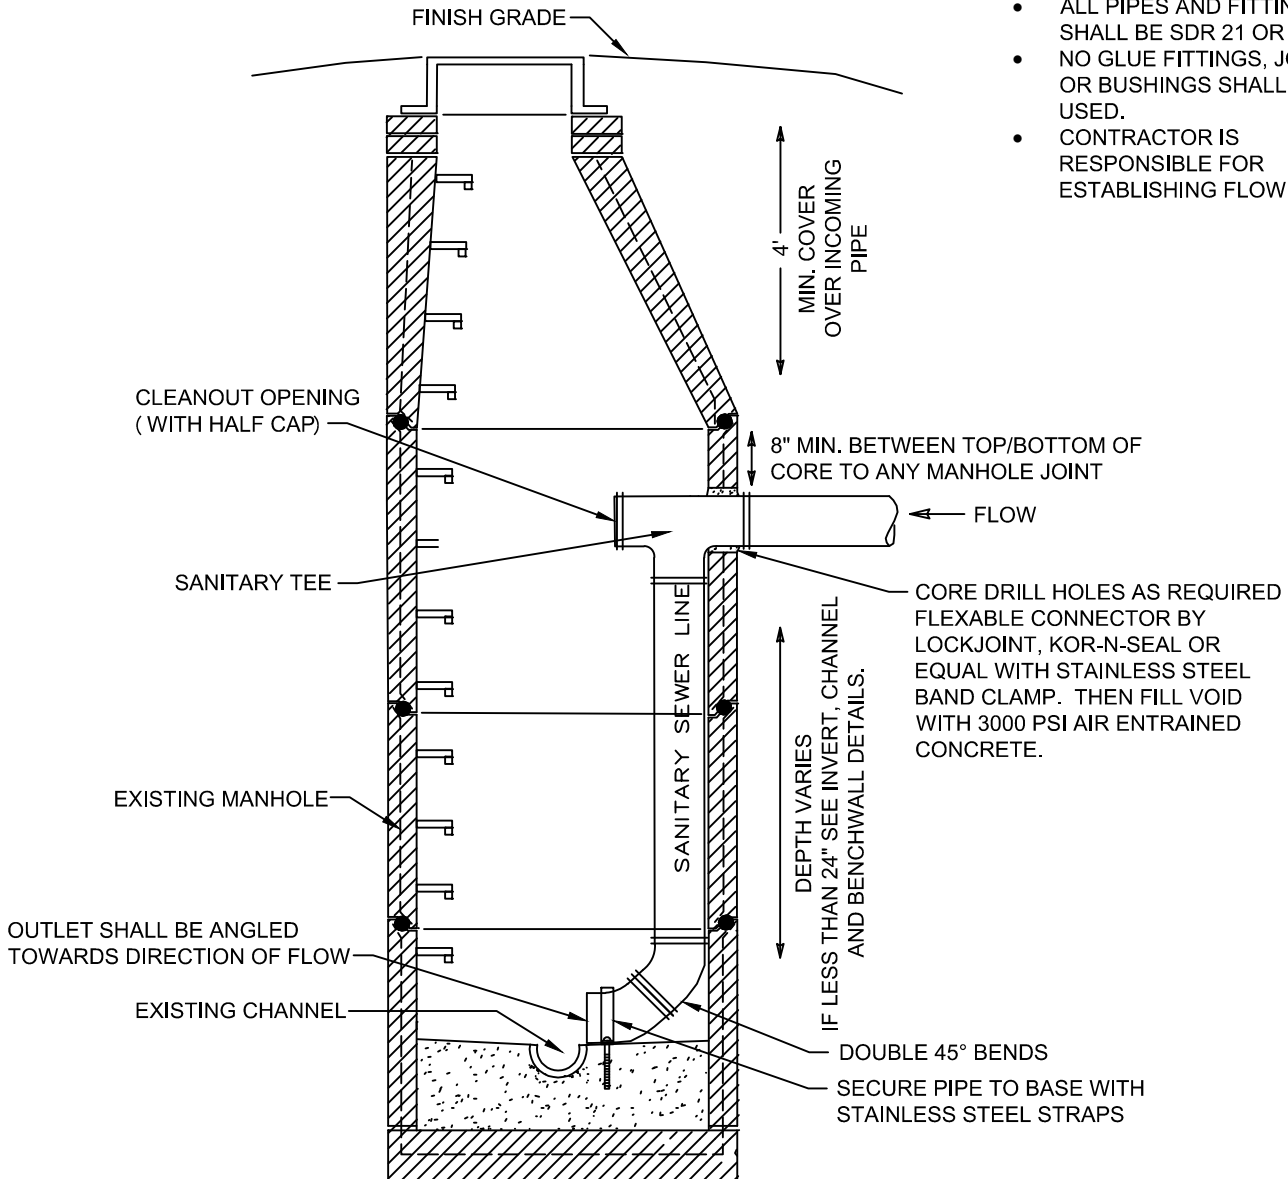

GRAVITY SEWER DROP CONNECTION TO EXISTING SANITARY MANHOLE (S.C.S.D. #1)
 NOT TO SCALE

SARATOGA COUNTY SEWER DISTRICT #1
 RESERVES THE RIGHT, AT OUR DISCRETION, TO CHANGE, MODIFY, ADD OR REMOVE PORTIONS OF THESE DETAIL SPEC'S AT ANY TIME



SARATOGA COUNTY SEWER DISTRICT #1

1002 HUDSON RIVER ROAD, MECHANICVILLE, NEW YORK

P.O. Box 550 Mechanicville, New York 12118
<http://www.saratogacountyny.gov/departments/sewer-district-1/>

Telephone: (518) 664-7396
 Fax: (518) 664-6280