


- NOTE:
- GRINDER PUMP MUST BE AT LEAST 10 FEET FROM FOUNDATION.
  - ALL COMPRESSION FITTINGS WILL BE BRASS OR STAINLESS STEEL OR APPROVED EQUAL.
  - ALL CURB STOP EXTENSION RODS SHALL BE STAINLESS STEEL.
  - HOPE/POLY PIPE REQUIRES THE USE OF STAINLESS STEEL INSERT PIPE STIFFENERS FOR ALL PACK JOINT/COMPRESSION CONNECTIONS.
  - STAINLESS STEEL, BRASS, OR FUSED DRESSER COUPLINGS TO BE USED WHERE EXISTING LINE IS CUT FOR TEE.
  - ALL FORCEMAIN SANITARY SEWER LINES SHALL BE AT A DEPTH OF 5' OR GREATER. IF LESS THAN 5' LINE SHALL BE INSULATED. (SEE SARATOGA COUNTY SEWER DISTRICT #1 TRENCH DETAIL).
  - WHEN CONNECTING TO EXISTING FORCEMAIN, CURB STOP MUST BE PLACED AS CLOSE AS POSSIBLE TO EXISTING FORCEMAIN AND OUTSIDE OF PAVEMENT WITH VALVE BOX.
  - TIE-IN SADDLE TO BE STAINLESS STEEL BANDED TAPPING SLEEVE, BANDED REPAIR SERVICE SADDLE, FULL CIRCLE REPAIR CLAMP FOR TAPPING BY SMITH BLAIR, PIPE FUSING, OR APPROVED EQUAL.
  - CONTRACTOR IS RESPONSIBLE FOR ESTABLISHING FLOW.

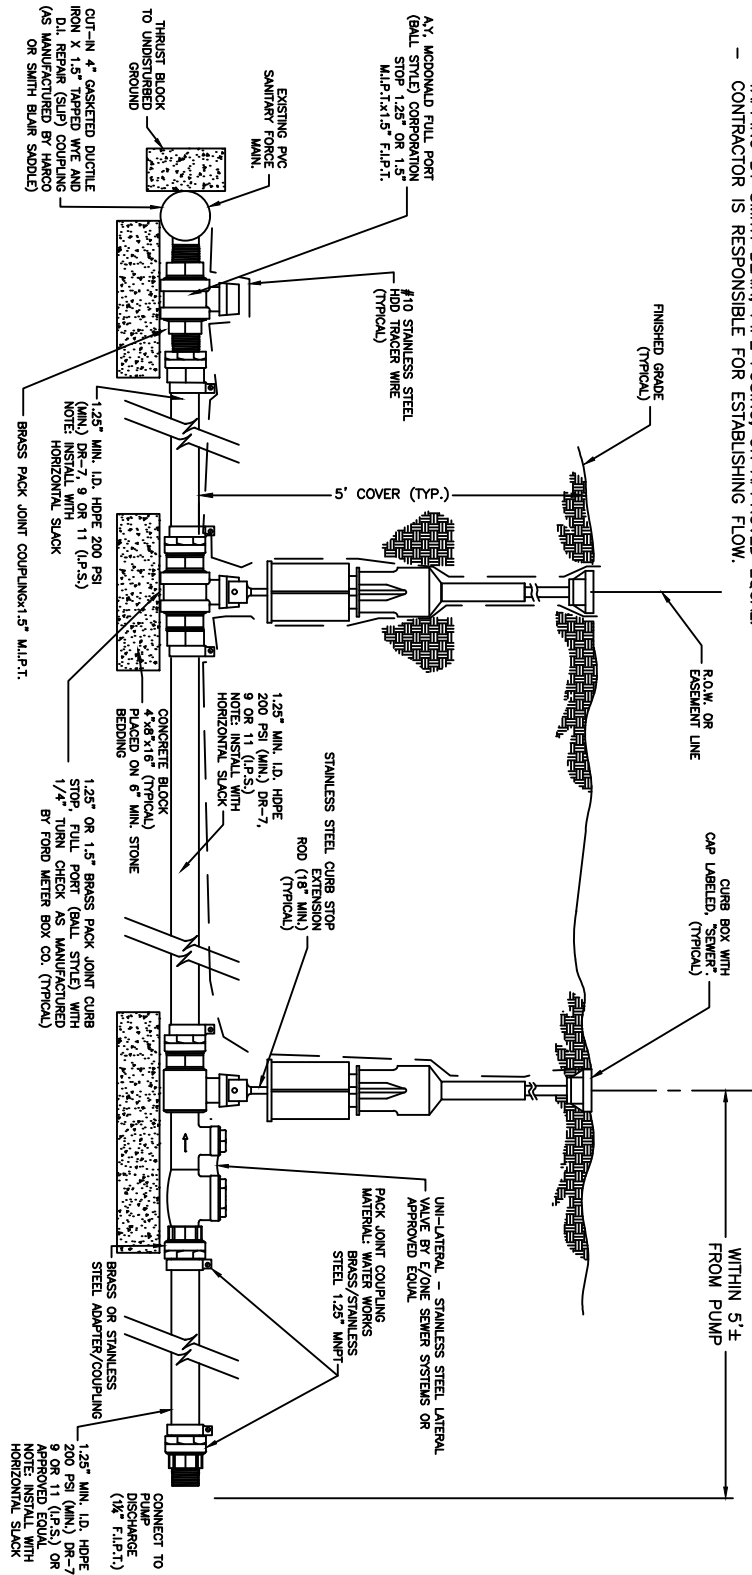

OUTDOOR GRINDER PUMP TO SANITARY FORCE MAIN CONNECTION

NOT TO SCALE

SARATOGA COUNTY SEWER DISTRICT #1  
RESERVES THE RIGHT, AT OUR DISCRETION, TO  
CHANGE, MODIFY, ADD OR REMOVE PORTIONS  
OF THESE DETAIL SPEC'S AT ANY TIME



# SARATOGA COUNTY SEWER DISTRICT #1

1002 HUDSON RIVER ROAD, MECHANICVILLE, NEW YORK

P.O. Box 550 Mechanicville, New York 12118  
http://www.saratogacountyny.gov/departments/sewer-district-1/

Telephone: (518) 664-7396  
Fax: (518) 664-6280